



ABS1413 Schematic
(1330mm height)



ABS1415 Schematic
(1530mm height)




**Accessories
Schematic**





ABOVE Ground Plumbing Connection

BELOW Ground Plumbing Connection

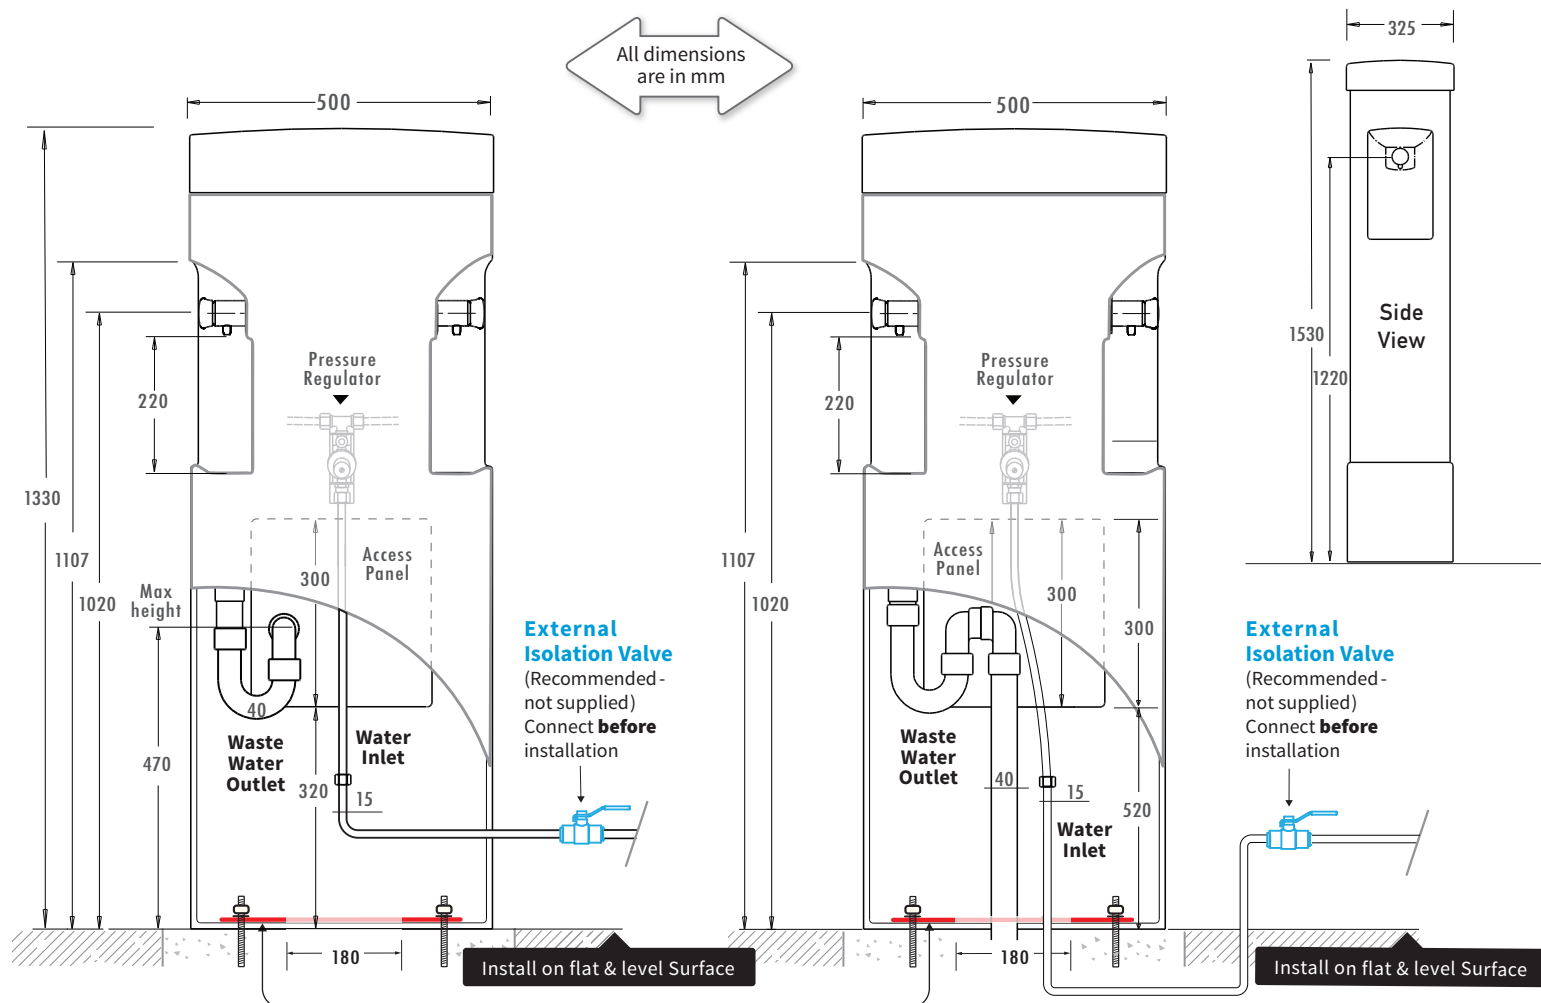


Rough in with Internal Base Mounting Plate (IBMP)

A. Place the IBMP
on **LEVEL**
mounting
surface and
mark holes





B. FIT OFF
either 12mm
threaded rods
or 16mm
dynabolts
(anchors)





C. PLACE UNIT
over anchors



D. EXPOSE Access Panel
by sliding poster up

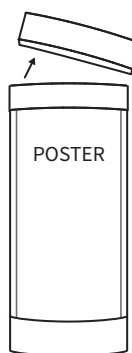


E. INSERT IBMP
through Access Panel
to inside of unit.
Lower plate over the
anchors **and secure**

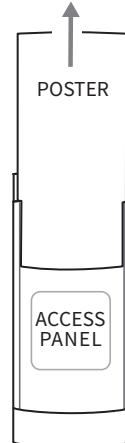

Check that ground is level

If ground is NOT LEVEL,
recess a level area
as suggested:

Ensure all edges are beveled
to avoid trip hazard

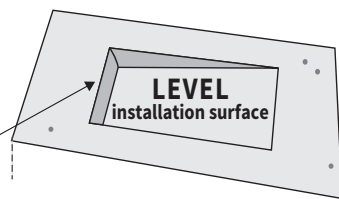

Determine Unit Orientation



NOTE:


POSTER will
NOT be visible
if installed next
to a wall

- Installation must be in accordance with AS/NZS 3500.1 & AS/NZS 3500.2
- Max water pressure 1000 kPa, Max temp 40°C
- Where installed in frost-prone areas, unit must be fitted with an Anti-Freeze Valve.



ABOVE Ground Plumbing Connection

BELOW Ground Plumbing Connection

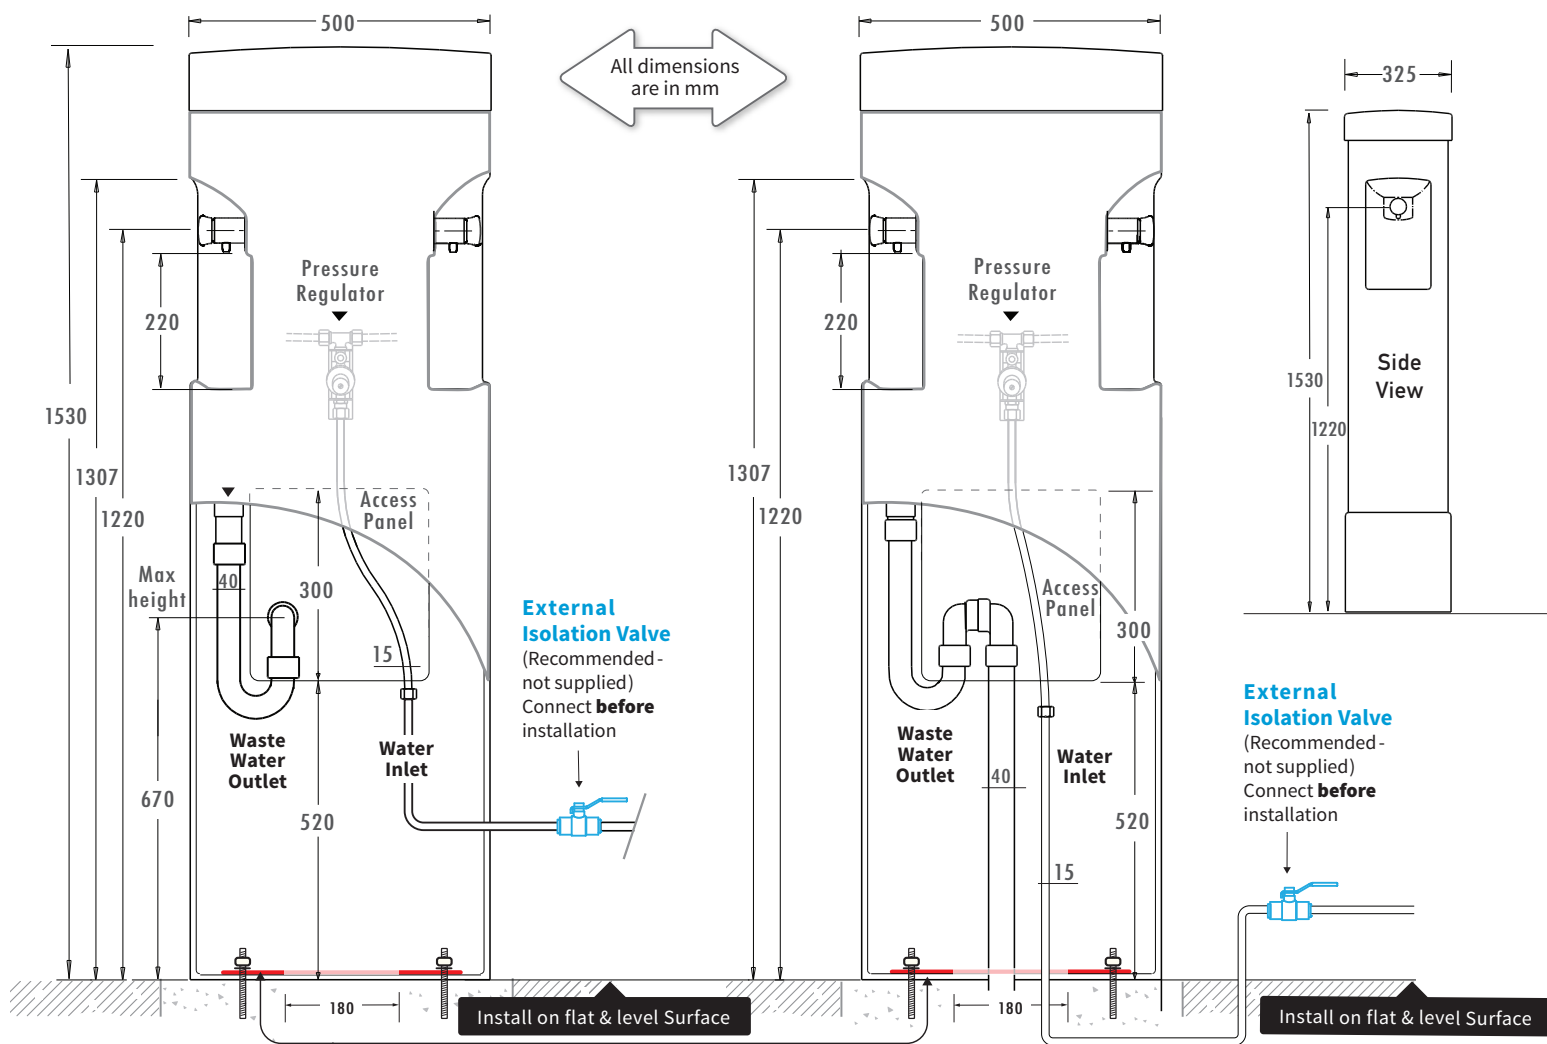


Rough in with Internal Base Mounting Plate (IBMP)

A. Place the IBMP on **LEVEL** mounting surface and mark holes






B. FIT OFF either 12mm threaded rods or 16mm dynabolts (anchors)



C. PLACE UNIT over anchors




D. EXPOSE Access Panel by sliding poster up

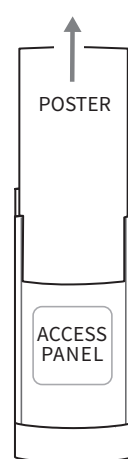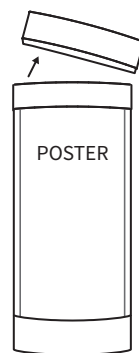

E. INSERT IBMP


through Access Panel to inside of unit. Lower plate over the anchors **and secure**



Check that ground is level

If ground is **NOT LEVEL**, recess a level area as suggested:

Ensure all edges are beveled to avoid trip hazard

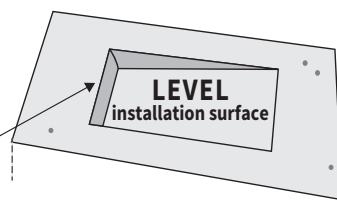

Determine Unit Orientation




NOTE:

POSTER will **NOT** be visible if installed next to a wall

- Installation must be in accordance with AS/NZS 3500.1 & AS/NZS 3500.2
- Max water pressure 1000 kPa, Max temp 40°C
- Where installed in frost-prone areas, unit must be fitted with an Anti-Freeze Valve.

DOG BOWL

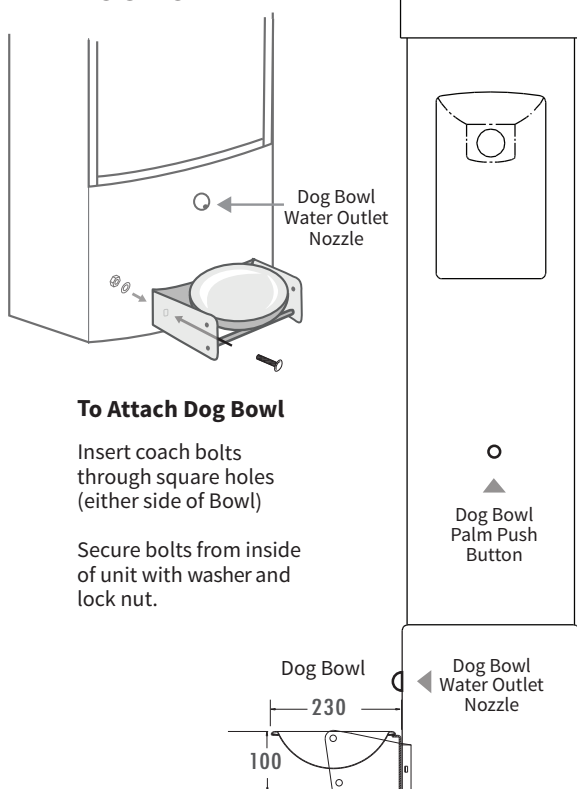

To Attach Dog Bowl


Insert coach bolts through square holes (either side of Bowl)

Secure bolts from inside of unit with washer and lock nut.

HANDS FREE PEDALS


Hands Free option not available for 1330mm unit.

Unit supplied with pedals attached - no assembly required.

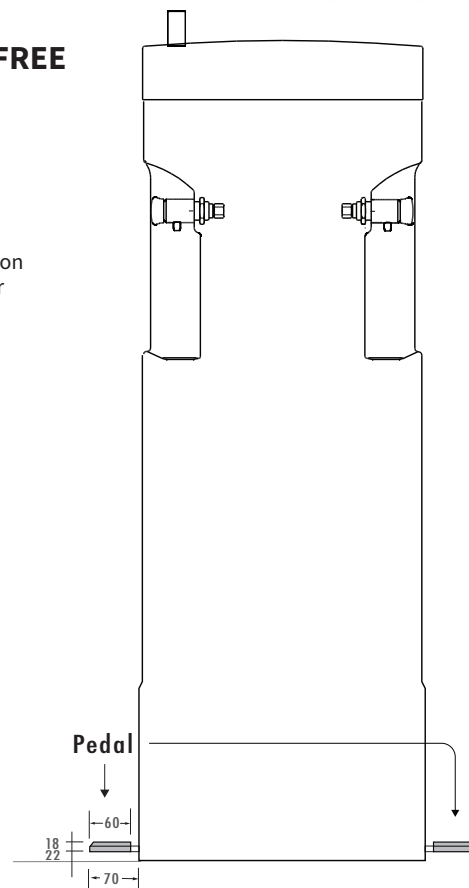


OUTDOOR TAP

Unit supplied with outdoor tap attached - no assembly required.

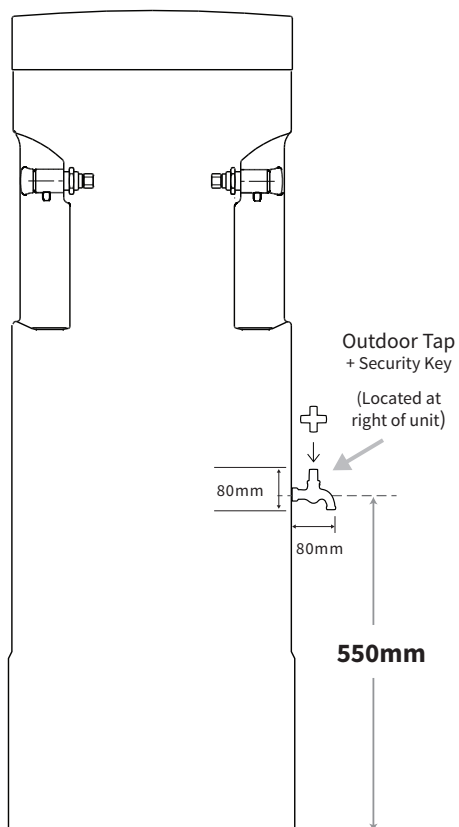

EXTERNAL CHILLER

Install the chiller on or behind a wall, or inside a cabinet provided with ventilation.

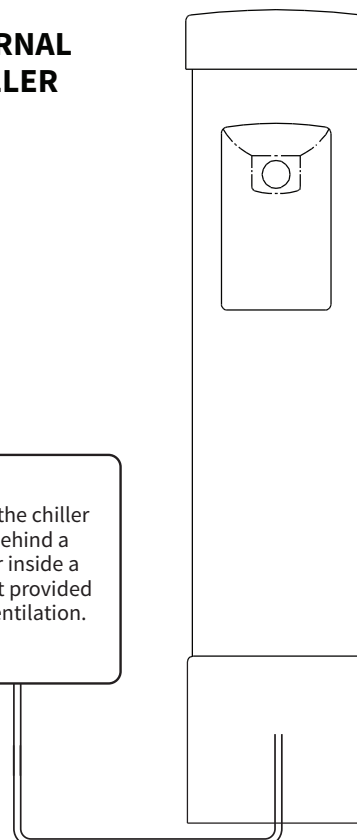

More information on the external chiller available upon request