

Page 1: Preinstallation Preparation

IMPORTANT * 1. Unit must be installed by a Certified Plumber 2. Installation must be in accordance with AS/NZS 3500.1 & AS/NZS 3500.2 max water pressure 1000 kPa, max temp 40°C 3. Where installed in frost-prone areas, unit must be fitted with an Anti-Freeze Valve. 4. Unit must be installed on a **flat & level** surface Nonadherence to any of the above, or failure to follow the steps detailed in this guide, will VOID ALL WARRANTIES

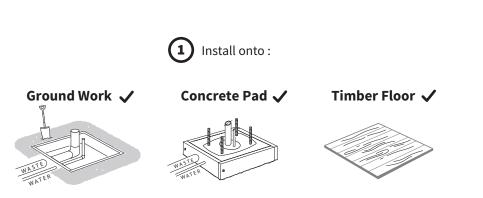

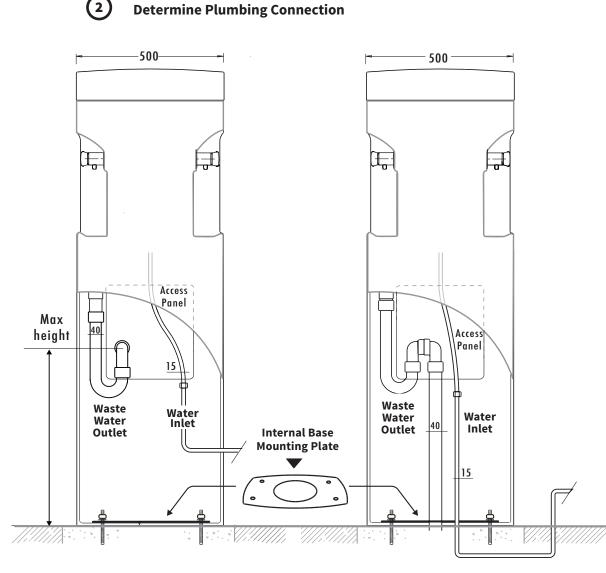

Above Ground

Below Ground


Page 2: Installation


Rough in with Internal Base Mounting Plate


Place Internal Base Mounting Plate (IBMP) in position on the installation surface.


- **A.** Mark anchor points on the surface through IBMP holes & drill out.
- **B.** Fit off either 12 mm threaded rods or 16mm dynabolts*
- **C.** Gain access to the base of the unit via Access Panel.
- **D.** Place unit over anchors, then place the Plate back inside unit over anchors and secure in place

*Indicates correct gauges for anchor system types listed; choice of anchor system is at installer's discretion

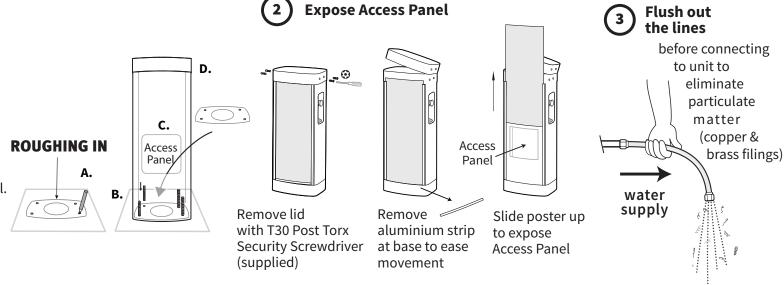

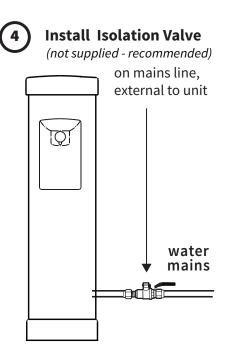

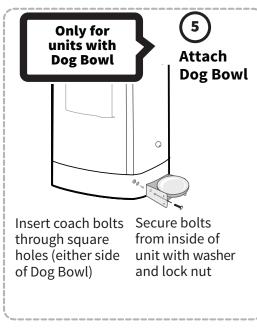




Check for leaks



Reassemble Poster
Secure lids with Screws
by T30 Security
Screwdriver



Before you go

Leave T30 Post Torx
Security Screwdriver
with client



